

Specification

General

The Powerex Enclosed Scroll Air Compressor unit is designed to provide clean, dry air for industrial applications where the quality of the compressed air is critical. The standard unit is rated for a maximum of 115 PSIG. A higher pressure version (max. 145 PSIG) is also available. The unit is UL/CSA certified¹.

Air Compressor System

The package shall include one oil-less scroll air compressor, a 13 gal. tank, and associated equipment. The only field connections required will be system exhaust, power connection at the control panel, and condensate tank drain connection. All interconnecting piping and wiring shall be included and operationally tested prior to shipment. Single phase 3HP units require installation of an additional external 30 gal. tank and single phase 5HP units require installation of an additional external 60 gal. tank. Anti-corrosion tank lining is available. Package includes sound reducing enclosure.

Sound Reducing Enclosure

The system is constructed with an internal frame and steel base system with an individual vibration isolation mounted compressor module. The sound reducing enclosure has side access panels to allow service of the electrical controls. The enclosure has side cooling air intakes and all exhaust air leaves the enclosure from the right side.

Oilless Scroll Compressor Pump

Each compressor shall be belt driven oil-less rotary scroll single stage, air-cooled oil-less construction with absolutely no oil needed for operation. The rotary design shall not require any inlet or exhaust valves and shall be rated for 100% continuous duty. Direct drive compressors shall not be used. Tip seals shall be of a composite PTFE material and be rated for 10,000 hours operation. Compressor bearings shall be external to the air compression chamber and shall all be serviceable for extended compressor life. Bearing maintenance shall not be required until 10,000 run hours. Compressors with bearings that are not accessible for service have a limited life span and shall not be accepted. Compressors shall have an integral radial flow fan for cooling and shall not require any additional electric cooling fans. Each compressor shall have flexible connectors on discharge.

Each compressor pump shall be provided with an electric drive motor, discharge check valve, an air-cooled after-cooler, and a high discharge temperature shut down switch.

Motor

Each compressor shall be belt driven by a 1750 RPM, ODP, NEMA construction motor. Motors running at speeds higher than 1750 RPM shall not be acceptable. Three phase motors are EISA compliant and premium efficient.

¹ With the exception of 5 HP single phase units, which only have a UL508A listed control panel.

Air Receiver

The system shall include an internal 13 gallon ASME air receiver rated for 175 PSI MAWP. The tank shall be equipped with a safety relief valve and a manual or optional automatic electronic tank drain with manual override. The tank will also have corrosion resistant FDA approved material tank lining if that option is selected.

System Controls

The system shall include a control panel with lighted on/off switch magnetic starter overload protection, hour meter, and high temperature shutoff switch.

Inlet Filters

The system shall include a single inlet filter system. The inlet filter system shall be located on the compressor pump.

Optional Desiccant Air Dryer

Each twin-tower desiccant dryer shall be sized for the peak calculated system demand to provide a pressure dew point of 0oF. Dryer controls shall include a re-pressurization cycle to prevent shocking of the desiccant bed prior to switching towers. An integral purge saving control system shall be provided and shall suspend the purge air loss during periods of low demand. When the dryer is in purge control mode, the tower switching valves shall not operate, and only one desiccant tower shall be on-line. Dryers that continue to operate the switching valves on a fixed cycle, while in purge control mode shall not be acceptable. Desiccant dryer controls are to be powered from a separate supply, not through compressor controls.

Optional Refrigerant Air Dryer

The refrigerated air dryer is non-cycling, direct expansion type, using R-134 A refrigerant (CFC free). A hot gas by-pass system maintains a consistent temperature at all load conditions. Heat exchangers are made of copper tube construction and fully insulated. Dryers shall have power on and high temperature lights, internal 3-micron filter/separator with stainless steel bowl, and timed electric condensate drain. Refrigerated dryers are to be powered from a separate supply, not through the compressor controls.



Optional Dewpoint Monitor

The system-integrated hygrometer shall be equipped with an LCD dew point display and high dew point alarm with dry contacts for remote monitoring. The sensor shall include an auto calibration feature to ensure the accuracy of the dew point measurement. Dew point monitor powered separately.

Optional Carbon Monoxide Monitor

The carbon monoxide (CO) monitor is provided in an enclosure with LCD display of CO concentrations. The monitor shall continuously display the CO content of the discharge air and shall provide audible and visual high CO alarms. High alarm is set at 10 ppm. Dry contacts are provided for remote monitoring of the high CO alarm. Carbon monoxide monitor powered separately.

Dimensions				
Model	Dim. A	Dim. B	Dim. C	Outlet
SES0308	34"	21"	33"	3/8"
SES1308	34"	21"	33"	3/8"
SES0508	34"	21"	33"	3/8"
SES1518	34"	21"	33"	3/8"

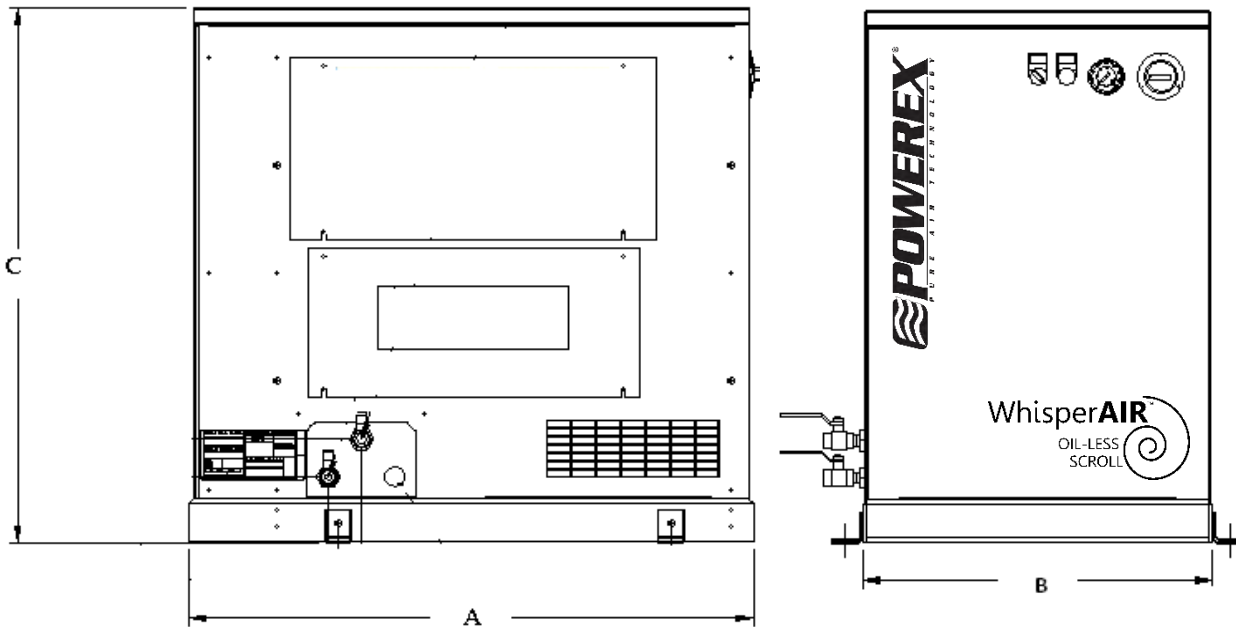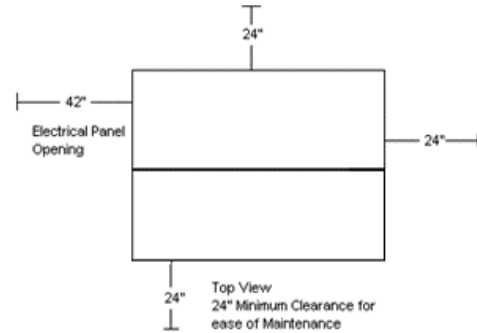

Enclosed Scroll Air Compressors										
Model ⁵	HP ¹	SCFM @ 100 PSIG ⁵	Maximum Pressure (PSIG)	Tank Size (gal) ⁶	BTU/Hr	dB(A) Level	System F.L.A.			System Weight (lbs)
							208V	230V	460V	
SES0308	3	8.8	116	13	7,635	49	9.0	8.1	4.2	310
SES0308HP	3	7.1	145	13	7,635	49	9.0	8.1	4.2	310
SES1308	3	8.8	116	13	7,635	49	-	13	-	336
SES1308HP	3	7.1	145	13	7,635	49	-	13	-	336
SES0508	5	15.2	116	13	12,725	51	14.5	13.1	6.6	335
SES0508HP	5	12.5	145	13	12,725	51	14.5	13.1	6.6	335
SES1518	5	15.2	116	13	12,725	51		23.4	-	345
SES1518HP	5	12.5	145	13	12,725	51		23.4	-	345

Notes:

- 1 – Actual BHP is less than rated name plate. Contact Powerex for BHP rating.
- 2 – 3 Year Limited Warranty
- 3 – Single Phase 3HP units will require installation of an additional 30 gal. external tank and 5HP units will require the installation of an additional 60 gal. external tank.
- 4 – UL/CSA Certified with the exception of 5 HP single phase units, which only have a UL508A listed control panel.
- 5 – HP after a model number indicates high pressure model. SCFM for high pressure units are @ 145 PSIG.
- 6 – Tank is located inside the enclosure

Specification

General

The Powerex Scroll Enclosed Air Compressor System is designed to provide clean, dry air for applications where the quality of the compressed air is critical. The standard unit is rated for a maximum of 115 PSIG. A high pressure version (max. 145 PSIG) is also available. The unit is UL/CSA certified.

Air Compressor System

The package shall include multiple oil-less scroll air compressors and associated equipment. The only field connections required will be system intake if remote intake option is chosen, exhaust, and power connection at the control panel.

Oilless Scroll Compressor Pump

Each compressor pump shall be belt driven oil-less rotary scroll single stage, air-cooled with absolutely no oil needed for operation. The rotary design shall not require any inlet or exhaust valves within the compressor pump housing or structure and shall be rated for 100% continuous duty. Direct drive compressors shall not be used. Tip seals shall be of a composite PTFE material and be rated for 10,000 hours operation (5,000 hours for high pressure version). Compressor pump bearings shall be external to the air compression chamber and pin crank and moving scroll bearings shall be serviceable for extended compressor life. Bearing maintenance shall not be required until 10,000 run hours (5,000 run hours for high pressure version). Compressor pumps with bearings that are not accessible for service have a limited life span and shall not be accepted. Compressor pumps shall have an integral radial flow fan for cooling. Each compressor pump shall have flexible connectors on intake and discharge. Each compressor pump shall have a non-metallic heat insulating liner for the discharge air pipe where it threads into the compressor housing.

Each compressor pump shall be provided with an electric drive motor, discharge check valve, an air-cooled after-cooler, and a high discharge temperature shut down switch. Auxiliary cooling fans shall operate from 120 volt power provided by the transformer included in the system controls.

Motor

Each compressor shall be belt driven by a 4 pole, TEFC, NEMA construction motor. Motors running at speeds higher than 1800 RPM shall not be acceptable. Motors are EISA compliant and premium efficient.

Air Receiver

The system shall include an internal 13 gallon ASME air receiver rated for 175 PSI MAWP. The tank shall be equipped with a safety relief valve and a manual or optional automatic electronic tank drain with manual override. The tank will also have corrosion resistant FDA approved material tank lining if that option is selected.

System Controls

The controls operate the duplex, triplex or quadplex air compressor

modules as needed in response to a pressure signal from a pressure transducer located in the system manifold. An illuminated on/off push button controls power to the motor starters. When the button is in the off position, the system is merely in stand-by mode, not powered off.

The pressure transducer sends a signal to the programmable logic controller (PLC) which is programmed to operate two, three or four compressor modules as needed to maintain the system pressure requirements. An HMI touch screen interface displays system status and alarm conditions. Pressure settings are user adjustable within factory predetermined setting limits.

The PLC will alternate each compressor module based on demand as well as timed alternation. If a compressor module is running longer than ten minutes continuously, the control will alternate to the next available compressor module to equalize run time and synchronize maintenance intervals. On initial startup or if air pressure drops rapidly, simultaneous motor starts are prevented by a programmed three second stagger. One 120VAC control circuit transformer with primary and secondary fuses is installed for control circuit voltage.

Motor circuit breakers with lockable disconnects are provided for each compressor module. Operating hours, high temperature alarms, motor overload alarms, run indication, and hours to scheduled maintenance for each compressor module are displayed on the screen. All alarm history is kept in the alarm log. Easily navigated menus are provided to allow the user to select the display conditions and acknowledge the alarms. Remote alarm contacts are provided as shown on the system wiring diagram.

Sound Reducing Enclosure

The system is constructed with an internal frame and steel base system with individual vibration isolation mounted compressor modules. The sound reducing enclosure has a front access panel to allow service of the electrical controls. The enclosure has rear cooling air intake and all exhaust air leaves the enclosure from the top.

Inlet Filters

The system includes a single inlet filter with a pleated element and a canister with silencing tubes. The single inlet filter serves all the compressor modules in the system. The filter is located inside the sound reducing cabinet protected by a convenient access panel.

Optional Desiccant Air Dryer

The twin-tower desiccant dryer(s) shall be sized for the peak calculated system demand to provide a pressure dew point of zero degrees F. Dryer controls shall include a re-pressurization cycle to prevent shocking of the desiccant bed prior to switching towers. An integral purge saving control system shall be provided and shall suspend the purge air loss during periods of low demand. When the dryer is in purge control mode, the tower switching valves shall not operate, and only one desiccant tower shall be on-line. Dryers that continue to operate the switching valves on a fixed cycle, while in purge control mode shall not be acceptable. (Dryers utilizing purge control require the optional dew point monitor listed below.) Each

dryer is supplied with two stages of filtration. The pre-filter removes particulates and liquids and includes an element change indicator and automatic condensate drain. The 0.5 micron after filter includes an element change indicator. Dryers shall be powered through a separate control circuit and not through the compressor controls.

Optional Refrigerant Air Dryer

The refrigerated air dryers are non-cycling, direct expansion type, using R-134 A refrigerant (CFC free). A hot gas by-pass system maintains a consistent temperature at all load conditions. Heat exchangers are made of copper tube construction and fully insulated. Dryers shall have power on and high temperature lights, suction pressure gauge, internal 3-micron filter/separator with stainless steel bowl, and timed electric condensate drain. Refrigerated dryers are to be powered from a separate supply, not through the compressor controls.

Optional Dewpoint Monitor

NOTE: Installed on desiccant dryer.

The system-integrated hygrometer shall be equipped with an LCD dewpoint display and high dewpoint alarm with dry contacts for remote monitoring. The sensor shall include an auto calibration feature to ensure the accuracy of the dewpoint measurement.




Optional Moisture Separator

The moisture separator shall be sized for the peak calculated demand and shall include an auto float drain to purge the collected moisture.

Optional Heat Manager

The Heat Manager fan system integrates with the Enclosed Scroll compressor unit to facilitate the flow of cooling air into an exhaust duct connected to the enclosure and removes the hot air out of the room or vicinity of the compressor unit. The cooling fan will operate when any pump inside the enclosure is running. The Heat Manager saves energy costs and ensures reliable compressor operation.

Dimensions				
Model	Dim. A	Dim. B	Dim. C	Outlet
SED1007	26"	38"	61"	1"
SED1007HP	26"	38"	61"	1"
SET1507	26"	38"	61"	1"
SET1507HP	26"	38"	61"	1"
SEQ2007	26"	38"	61"	1"
SEQ2007HP	26"	38"	61"	1"

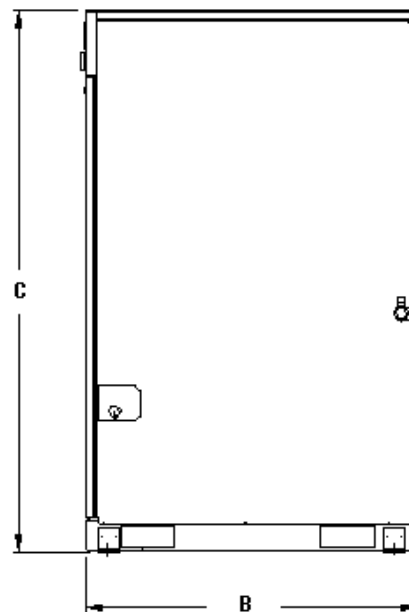
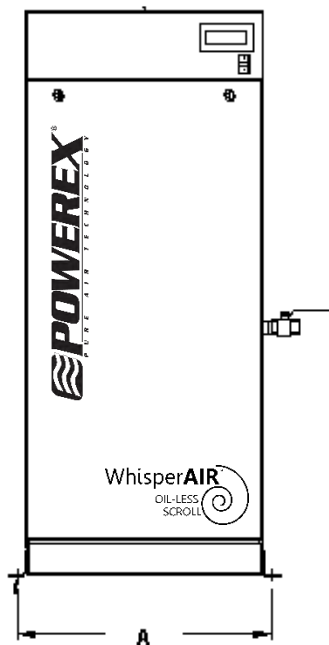
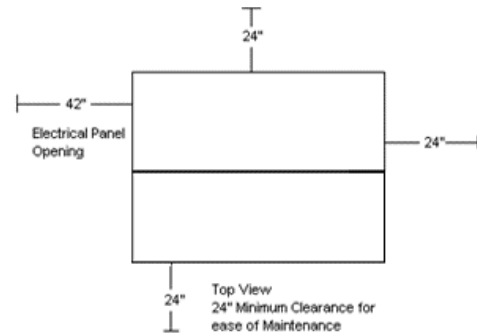


Enclosed Scroll Air Compressors										
Model ⁴	Total System HP	Pump HP ¹	SCFM @ 100 PSIG ⁴	Maximum Pressure (PSIG)	BTU/Hr	dB(A) Level	System F.L.A.			System Weight (lbs)
							208V	230V	460V	
SED1007	10	5 (2)	30.4	116	25,450	53	30.8	28.0	15.0	825
SED1007HP	10	5 (2)	25.0	145	25,450	53	30.8	28.0	15.0	825
SET1507	15	5 (3)	45.6	116	38,175	56	45.2	41.0	21.5	965
SET1507HP	15	5 (3)	37.5	145	38,175	56	45.2	41.0	21.5	965
SEQ2007	20	5 (4)	60.8	116	50,900	58	59.6	54.0	28.0	1,125
SEQ2007HP	20	5 (4)	50.0	145	50,900	58	59.6	54.0	28.0	1,125

Notes:

- 1 – Actual BHP is less than rated name plate. Contact Powerex for BHP rating.
- 2 – 3 Year Limited Warranty
- 3 – UL/CSA Certified
- 4 – HP after a model number indicates high pressure model. SCFM for high pressure units are @ 145 PSIG.

Dimensions				
Model	Dim. A	Dim. B	Dim. C	Outlet
SED1007	26"	38"	83.5"	1"
SED1007HP	26"	38"	83.5"	1"
SET1507	26"	38"	83.5"	1"
SET1507HP	26"	38"	83.5"	1"
SEQ2007	26"	38"	83.5"	1"
SEQ2007HP	26"	38"	83.5"	1"

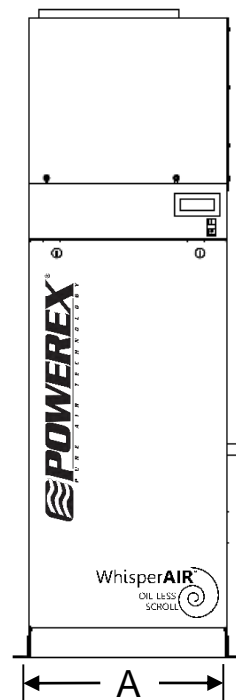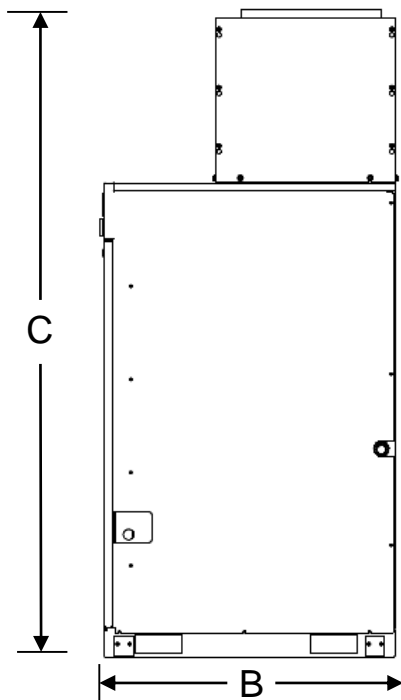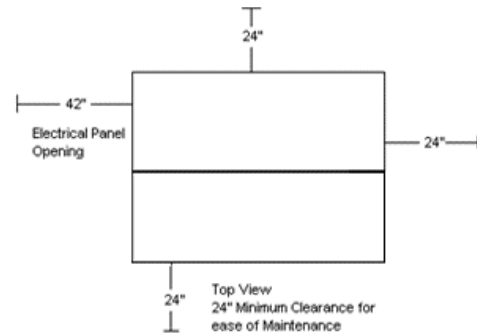

Enclosed Scroll Air Compressors										
Model ⁴	Total System HP	Pump HP ¹	SCFM @ 100 PSIG ⁴	Maximum Pressure (PSIG)	BTU/Hr	dB(A) Level	System F.L.A.			System Weight (lbs)
							208V	230V	460V	
SED1007	10	5 (2)	30.4	116	25,450	55	30.8	28.0	15.0	925
SED1007HP	10	5 (2)	25.0	145	25,450	55	30.8	28.0	15.0	925
SET1507	15	5 (3)	45.6	116	38,175	58	45.2	41.0	21.5	1,065
SET1507HP	15	5 (3)	37.5	145	38,175	58	45.2	41.0	21.5	1,065
SEQ2007	20	5 (4)	60.8	116	50,900	60	59.6	54.0	28.0	1,225
SEQ2007HP	20	5 (4)	50.0	145	50,900	60	59.6	54.0	28.0	1,225

Notes:

- 1 – Actual BHP is less than rated name plate. Contact Powerex for BHP rating.
- 2 – 3 Year Limited Warranty
- 3 – UL/CSA Certified
- 4 – HP after a model number indicates high pressure model. SCFM for high pressure units are @ 145 PSIG.

Specification

General

The Powerex Enclosed Scroll Air Compressor System is designed to provide clean, dry air for applications where the quality of the compressed air is critical. The standard unit is rated for a maximum of 115 PSIG. A high pressure version (max. 145 PSIG) is also available.

Air Compressor System

The package shall include multiple oil-less scroll air compressors and associated equipment. The only field connections required will be system intake if remote intake option is chosen, exhaust, and power connection at the control panel.

Oilless Scroll Compressor Pump

Each compressor pump shall be belt driven oil-less rotary scroll single stage, air-cooled with absolutely no oil needed for operation. The rotary design shall not require any inlet or exhaust valves within the compressor pump housing or structure and shall be rated for 100% continuous duty. Direct drive compressors shall not be used. Tip seals shall be of a composite PTFE material and be rated for 10,000 hours operation (5,000 hours for high pressure version). Compressor pump bearings shall be external to the air compression chamber and pin crank and moving scroll bearings shall be serviceable for extended compressor life. Bearing maintenance shall not be required until 10,000 run hours (5,000 run hours for high pressure version). Compressor pumps with bearings that are not accessible for service have a limited life span and shall not be accepted. Compressor pumps shall have an integral radial flow fan for cooling. Each compressor pump shall have flexible connectors on intake and discharge. Each compressor pump shall have a non-metallic heat insulating liner for the discharge air pipe where it threads into the compressor housing.

Each compressor pump shall be provided with an electric drive motor, discharge check valve, an air-cooled after-cooler, and a high discharge temperature shut down switch. Auxiliary cooling fans shall operate from 120 volt power provided by the transformer included in the system controls.

Motor

Each compressor shall be belt driven by a 4 pole, TEFC, NEMA construction motor. Motors running at speeds higher than 1800 RPM shall not be acceptable. Motors are EISA compliant and premium efficient.

System Controls

The controls operate the six or eight air compressor modules as needed in response to a pressure signal from a pressure transducer located in the system manifold. An illuminated on/off push button controls power to the motor starters. When the button is in the off position, the system is merely in stand-by mode, not powered off.

The pressure transducer sends a signal to the programmable logic controller (PLC) which is programmed to operate six or eight compressor modules as needed to maintain the system pressure requirements. An HMI touch screen interface displays system status

and alarm conditions. Pressure settings are user adjustable within factory predetermined setting limits.

The PLC will alternate each compressor module based on demand as well as timed alternation. If a compressor module is running longer than ten minutes continuously, the control will alternate to the next available compressor module to equalize run time and synchronize maintenance intervals. On initial start up or if air pressure drops rapidly, simultaneous motor starts are prevented by a programmed three second stagger. One 120VAC control circuit transformer with primary and secondary fuses is installed for control circuit voltage. Motor circuit breakers with lockable disconnects are provided for each compressor module. Operating hours, high temperature alarms, motor overload alarms, run indication, and hours to scheduled maintenance for each compressor module are displayed on the screen. All alarm history is kept in the alarm log. Easily navigated menus are provided to allow the user to select the display conditions and acknowledge the alarms. Remote alarm contacts are provided as shown on the system wiring diagram.

Inlet Filters

The system includes two inlet filters, each with a pleated element and a canister with silencing tubes. Each inlet filter serves half the compressor modules in the system. Each filter is located inside the sound reducing cabinet protected by a convenient access panel.

Sound Reducing Enclosure

The system is constructed with an internal frame and steel base system with individual vibration isolation mounted compressor modules. The sound reducing enclosure has a front access panel to allow service of the electrical controls. The enclosure has rear cooling air intake and all exhaust air leaves the enclosure from the top.

Optional Desiccant Air Dryer

The twin-tower desiccant dryer(s) shall be sized for the peak calculated system demand to provide a pressure dew point of 0°F. Dryer controls shall include a re-pressurization cycle to prevent shocking of the desiccant bed prior to switching towers. An integral purge saving control system shall be provided and shall suspend the purge air loss during periods of low demand. When the dryer is in purge control mode, the tower switching valves shall not operate, and only one desiccant tower shall be on-line. Dryers that continue to operate the switching valves on a fixed cycle, while in purge control mode shall not be acceptable. (Dryers utilizing purge control require the optional dew point monitor listed below.) Each dryer is supplied with two stages of filtration. The pre-filter removes particulates and liquids and includes an element change indicator and automatic condensate drain. The 0.5 micron after filter includes an element change indicator. Dryers shall be powered through a separate control circuit and not through the compressor controls.

Optional Refrigerant Air Dryer

The refrigerated air dryers are non-cycling, direct expansion type, using R-134 A refrigerant (CFC free). A hot gas by-pass system maintains a consistent temperature at all load conditions. Heat exchangers are

made of copper tube construction and fully insulated. Dryers shall have power on and high temperature lights, suction pressure gauge, internal 3-micron filter/separator with stainless steel bowl, and timed electric condensate drain. Refrigerated dryers are to be powered from a separate supply, not through the compressor controls.

Optional Dewpoint Monitor




NOTE: Installed on desiccant dryer.

The system-integrated hygrometer shall be equipped with an LCD dewpoint display and high dewpoint alarm with dry contacts for remote monitoring. The sensor shall include an auto calibration feature to ensure the accuracy of the dewpoint measurement.

Optional Moisture Separator

The moisture separator shall be sized for the peak calculated demand and shall include an auto float drain to purge the collected moisture.

Dimensions				
Model	Dim. A	Dim. B	Dim. C	Outlet
SEH3007	38"	58"	62"	1"
SEH3007HP	38"	58"	62"	1"
SEO4007	38"	58"	62"	1"
SEO4007HP	38"	58"	62"	1"

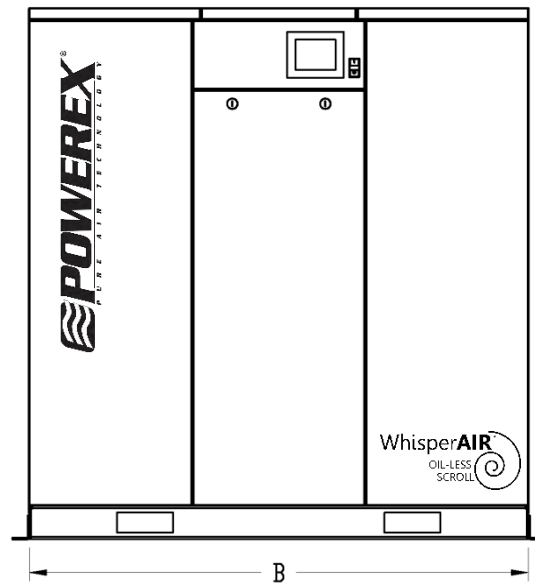
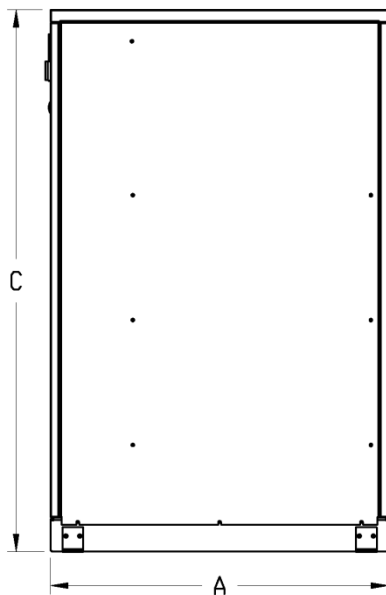
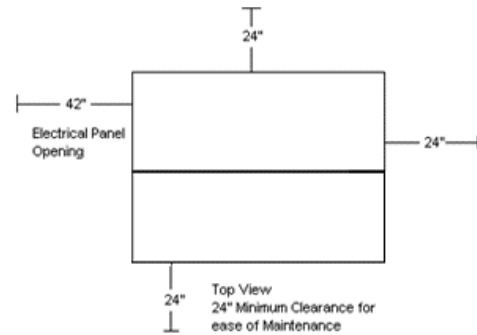


Enclosed Scroll Air Compressors										
Model ³	Total System HP	Pump HP ¹	SCFM @ 100 PSIG ³	Maximum Pressure (PSIG)	BTU/Hr	dB(A) Level	System F.L.A.			System Weight (lbs)
							208V	230V	460V	
SEH3007	30	5 (6)	91.2	116	76,350	59	88.4	80.0	40.9	1,640
SEH3007HP	30	5 (6)	75.0	145	76,350	59	88.4	80.0	40.9	1,640
SEO4007	40	5 (8)	121.6	116	101,800	60	117.2	106	53.9	2,000
SEO4007HP	40	5 (8)	100.0	145	101,800	60	117.2	106	53.9	2,000

Notes:

- 1 – Actual BHP is less than rated name plate. Contact Powerex for BHP rating.
- 2 – 3 Year Limited Warranty
- 3 – HP after a model number indicates high pressure model. SCFM for high pressure units are @ 145 PSIG.

Dimensions				
Model	Dim. A	Dim. B	Dim. C	Outlet
SEH3007	38"	58"	83.5"	1"
SEH3007HP	38"	58"	83.5"	1"
SEO4007	38"	58"	83.5"	1"
SEO4007HP	38"	58"	83.5"	1"

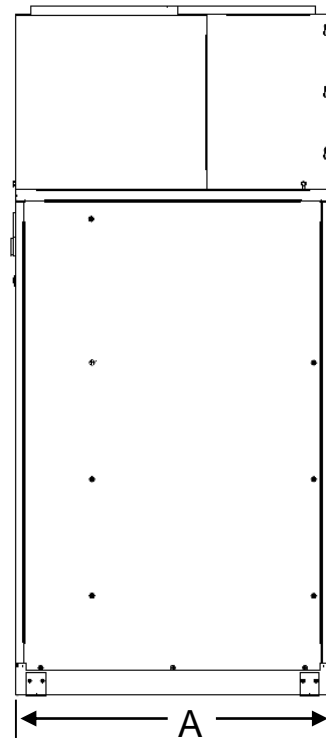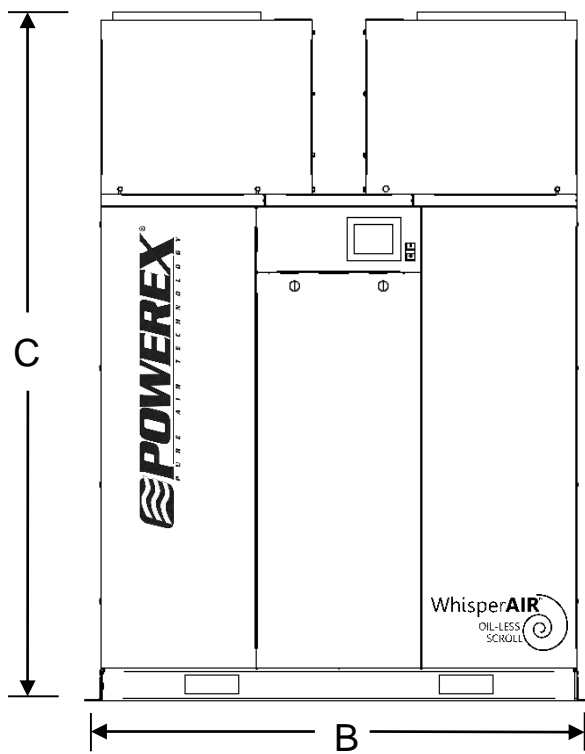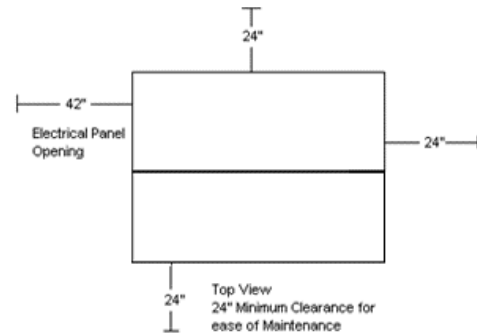

Enclosed Scroll Air Compressors										
Model ³	Total System HP	Pump HP ¹	SCFM @ 100 PSIG ³	Maximum Pressure (PSIG)	BTU/Hr	dB(A) Level	System F.L.A.			System Weight (lbs)
							208V	230V	460V	
SEH3007	30	5 (6)	91.2	116	76,350	62	88.4	80.0	40.9	1,840
SEH3007HP	30	5 (6)	75.0	145	76,350	62	88.4	80.0	40.9	1,840
SEO4007	40	5 (8)	121.6	116	101,800	63	117.2	106	53.9	2,200
SEO4007HP	40	5 (8)	100.0	145	101,800	63	117.2	106	53.9	2,200

Notes:

- 1 – Actual BHP is less than rated name plate. Contact Powerex for BHP rating.
- 2 – 3 Year Limited Warranty
- 3 – HP after a model number indicates high pressure model. SCFM for high pressure units are @ 145 PSIG.

Specification

General

The Powerex Scroll Enclosed Air Compressor System is designed to provide clean, dry air for applications where the quality of the compressed air is critical. The standard unit is rated for a maximum of 116 PSIG.

Air Compressor System

The package shall include multiple oil-less scroll air compressors and associated equipment. The only field connections required will be system intake if remote intake option is chosen, exhaust, and power connection at the control panel.

Oilless Scroll Compressor Pump

Each compressor pump shall be belt driven oil-less rotary scroll single stage, air-cooled with absolutely no oil needed for operation. The rotary design shall not require any inlet or exhaust valves within the compressor pump housing or structure and shall be rated for 100% continuous duty. Direct drive compressors shall not be used. Tip seals shall be of a composite PTFE material and be rated for 8,000 hours operation. Compressor pump bearings shall be external to the air compression chamber and pin crank and moving scroll bearings shall be serviceable for extended compressor life. Bearing maintenance shall not be required until 8,000 run hours. Compressor pumps with bearings that are not accessible for service have a limited life span and shall not be accepted. Compressor pumps shall have an integral radial flow fan for cooling. Each compressor pump shall have flexible connectors on intake and discharge. Each compressor pump shall have a non-metallic heat insulating liner for the discharge air pipe where it threads into the compressor housing.

Each compressor pump shall be provided with an electric drive motor, discharge check valve, an air-cooled after-cooler, and a high discharge temperature shut down switch. Auxiliary cooling fans shall operate from 120 volt power provided by the transformer included in the system controls.

Approach Temperatures

The system is designed with 3 stages of internal aftercooling so to have a maximum approach temperature of 16°F after the tank and 20°F immediately after the compressor above ambient. No additional external aftercooling is required for use with a dryer.

Motor

Each compressor shall be belt driven by a 2 pole, TEFC, NEMA construction motor that run at 3500 RPM. Motors are EISA compliant and premium efficient.

Motor Slide Base

Maintenance feature designed for easy adjustment of belt tension from the motor side on the basemount assembly.

- Robust single screw linear belt tension adjustment.
- Custom compact design.

System Controls

The controls operate the duplex or triplex air compressor modules as needed in response to a pressure signal from a pressure transducer located in the system manifold. An illuminated on/off push button controls power to the motor starters. When the button is in the off position, the system is merely in stand-by mode, not powered off.

The pressure transducer sends a signal to the programmable logic controller (PLC) which is programmed to operate two, three or four compressor modules as needed to maintain the system pressure requirements. An HMI touch screen interface displays system status and alarm conditions. Pressure settings are user adjustable within factory predetermined setting limits.

The PLC will alternate each compressor module based on demand as well as timed alternation. If a compressor module is running longer than ten minutes continuously, the control will alternate to the next available compressor module to equalize run time and synchronize maintenance intervals. On initial startup or if air pressure drops rapidly, simultaneous motor starts are prevented by a programmed three second stagger. One 120VAC control circuit transformer with primary and secondary fuses is installed for control circuit voltage.

Motor circuit breakers with lockable disconnects are provided for each compressor module. Operating hours, high temperature alarms, motor overload alarms, run indication, and hours to scheduled maintenance for each compressor module are displayed on the screen. All alarm history is kept in the alarm log. Easily navigated menus are provided to allow the user to select the display conditions and acknowledge the alarms. Remote alarm contacts are provided as shown on the system wiring diagram.

Inlet Filters

The system includes an inlet filter with a pleated element and a canister with silencing tubes for each pump. The filters are located on each pump inside the sound reducing cabinet protected by a convenient access panel.

Sound Reducing Enclosure

The system is constructed with an internal frame and steel base system with individual vibration isolation mounted compressor modules. The sound reducing enclosure has a front access panel to allow service of the electrical controls. The enclosure has rear cooling air intake and all exhaust air leaves the enclosure from the top.

Optional Desiccant Air Dryer

The twin-tower desiccant dryer(s) shall be sized for the peak calculated system demand to provide a pressure dew point of zero degrees F. Dryer controls shall include a re-pressurization cycle to prevent shocking of the desiccant bed prior to switching towers. An integral purge saving control system shall be provided and shall suspend the purge air loss during periods of low demand. When the dryer is in purge control mode, the tower switching valves shall not operate, and only one desiccant tower shall be on-line. Dryers that continue to operate the switching valves on a fixed cycle, while in purge control mode shall not be acceptable. (Dryers utilizing purge

control require the optional dew point monitor listed below.) Each dryer is supplied with two stages of filtration. The pre-filter removes particulates and liquids and includes an element change indicator and automatic condensate drain. The 0.5 micron after filter includes an element change indicator. Dryers shall be powered through a separate control circuit and not through the compressor controls.

Optional Refrigerant Air Dryer

The refrigerated air dryers are non-cycling, direct expansion type, using R-134 A refrigerant (CFC free). A hot gas by-pass system maintains a consistent temperature at all load conditions. Heat exchangers are made of copper tube construction and fully insulated. Dryers shall have power on and high temperature lights, suction pressure gauge, internal 3-micron filter/separator with stainless steel bowl, and timed electric condensate drain. Refrigerated dryers are to be powered from a separate supply, not through the compressor controls.

Optional Dewpoint Monitor




NOTE: Installed on desiccant dryer.

The system-integrated hygrometer shall be equipped with an LCD dewpoint display and high dewpoint alarm with dry contacts for remote monitoring. The sensor shall include an auto calibration feature to ensure the accuracy of the dewpoint measurement.

Optional Moisture Separator

The moisture separator shall be sized for the peak calculated demand and shall include an auto float drain to purge the collected moisture.

Dimensions				
Model	Dim. A	Dim. B	Dim. C	Outlet
SED15B	42"	34"	62 "	1"
SED20B	42"	34"	62 "	1"
SET225	42"	34"	62 "	1"
SET30B	42"	34"	62 "	1"

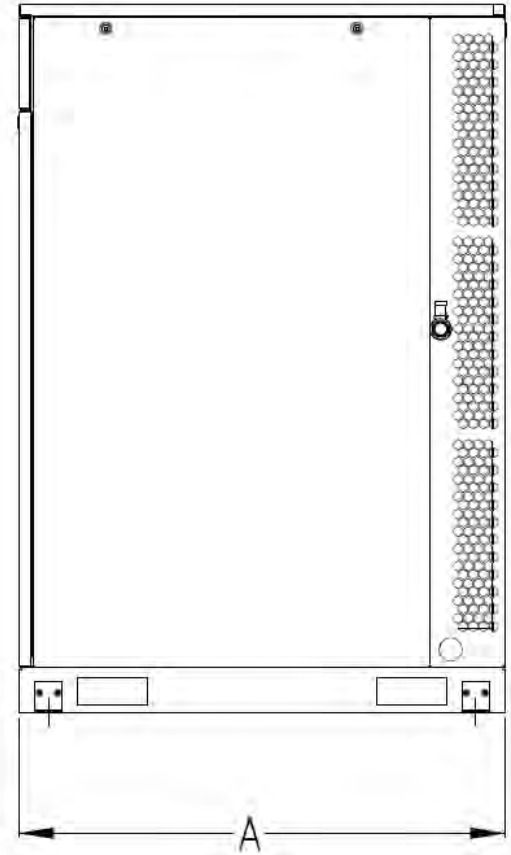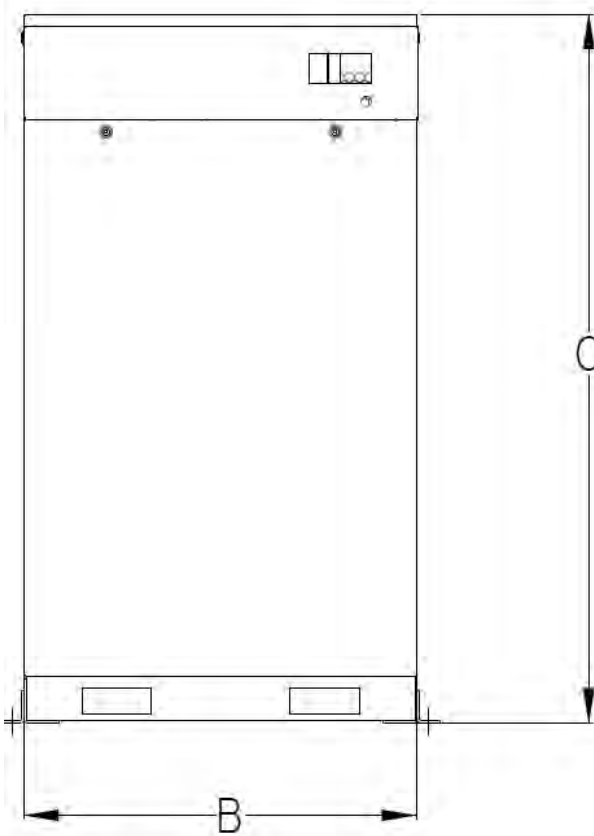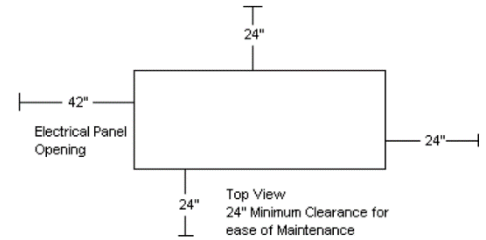

Enclosed Scroll Air Compressors										
Model	Total System HP	Pump HP ¹	SCFM @ 100 PSIG	Maximum Pressure (PSIG)	BTU/Hr	dB(A) Level	System F.L.A.			System Weight (lbs)
							208V	230V	460V	
SED15B	15	7.5 (2)	46.2	116	38,200	63	40.2	36.6	19.3	840
SED20B	20	10 (2)	62.4	116	50,934	64	52.8	48	25	840
SET225	22.5	7.5 (3)	69.3	116	57,350	65	59.3	53.9	27.9	1110
SET30B	30	10 (3)	93.6	116	76,401	66	78.2	71	36.5	1110

Notes:

- 1 – Actual BHP is less than rated name plate. Contact Powerex for BHP rating.
- 2 – 3 Year Limited Warranty
- 3 – UL/CSA Certified

Specification

General

The Powerex Scroll Enclosed Air Compressor System is designed to provide clean, dry air for applications where the quality of the compressed air is critical. The standard unit is rated for a maximum of 116 PSIG.

Air Compressor System

The package shall include multiple oil-less scroll air compressors and associated equipment. The only field connections required will be system intake if remote intake option is chosen, exhaust, and power connection at the control panel.

Oilless Scroll Compressor Pump

Each compressor pump shall be belt driven oil-less rotary scroll single stage, air-cooled with absolutely no oil needed for operation. The rotary design shall not require any inlet or exhaust valves within the compressor pump housing or structure and shall be rated for 100% continuous duty. Direct drive compressors shall not be used. Tip seals shall be of a composite PTFE material and be rated for 8,000 hours operation. Compressor pump bearings shall be external to the air compression chamber and pin crank and moving scroll bearings shall be serviceable for extended compressor life. Bearing maintenance shall not be required until 8,000 run hours. Compressor pumps with bearings that are not accessible for service have a limited life span and shall not be accepted. Compressor pumps shall have an integral radial flow fan for cooling. Each compressor pump shall have flexible connectors on intake and discharge. Each compressor pump shall have a non-metallic heat insulating liner for the discharge air pipe where it threads into the compressor housing.

Each compressor pump shall be provided with an electric drive motor, discharge check valve, an air-cooled after-cooler, and a high discharge temperature shut down switch. Auxiliary cooling fans shall operate from 120 volt power provided by the transformer included in the system controls.

Approach Temperatures

The system is designed with 3 stages of internal aftercooling so to have a maximum approach temperature of 16°F after the tank and 20°F immediately after the compressor above ambient. No additional external aftercooling is required for use with a dryer.

Motor

Each compressor shall be belt driven by a 2 pole, TEFC, NEMA construction motor that run at 3500 RPM. Motors are EISA compliant and premium efficient.

Motor Slide Base

Maintenance feature designed for easy adjustment of belt tension from the motor side on the basemount assembly.

- Robust single screw linear belt tension adjustment.
- Custom compact design.

System Controls

The controls operate the duplex or triplex air compressor modules as needed in response to a pressure signal from a pressure transducer located in the system manifold. An illuminated on/off push button controls power to the motor starters. When the button is in the off position, the system is merely in stand-by mode, not powered off.

The pressure transducer sends a signal to the programmable logic controller (PLC) which is programmed to operate two, three or four compressor modules as needed to maintain the system pressure requirements. An HMI touch screen interface displays system status and alarm conditions. Pressure settings are user adjustable within factory predetermined setting limits.

The PLC will alternate each compressor module based on demand as well as timed alternation. If a compressor module is running longer than ten minutes continuously, the control will alternate to the next available compressor module to equalize run time and synchronize maintenance intervals. On initial startup or if air pressure drops rapidly, simultaneous motor starts are prevented by a programmed three second stagger. One 120VAC control circuit transformer with primary and secondary fuses is installed for control circuit voltage.

Motor circuit breakers with lockable disconnects are provided for each compressor module. Operating hours, high temperature alarms, motor overload alarms, run indication, and hours to scheduled maintenance for each compressor module are displayed on the screen. All alarm history is kept in the alarm log. Easily navigated menus are provided to allow the user to select the display conditions and acknowledge the alarms. Remote alarm contacts are provided as shown on the system wiring diagram.

Compressor Bank Isolation

The system shall include shut-off ball valves, safety relief valve, lockable motor protectors, and a miniature circuit breaker for low voltage components that enables isolation of half of the compressor pumps to allow OSHA approved service and maintenance while the other half is in operation.

Inlet Filters

The system includes an inlet filter with a pleated element and a canister with silencing tubes for each pump. The filters are located on each pump inside the sound reducing cabinet protected by a convenient access panel.

Sound Reducing Enclosure

The system is constructed with an internal frame and steel base system with individual vibration isolation mounted compressor modules. The sound reducing enclosure has a front access panel to allow service of the electrical controls. The enclosure has rear cooling air intake and all exhaust air leaves the enclosure from the top.

Optional Desiccant Air Dryer

The twin-tower desiccant dryer(s) shall be sized for the peak calculated system demand to provide a pressure dew point of zero degrees F. Dryer controls shall include a re-pressurization cycle to

prevent shocking of the desiccant bed prior to switching towers. An integral purge saving control system shall be provided and shall suspend the purge air loss during periods of low demand. When the dryer is in purge control mode, the tower switching valves shall not operate, and only one desiccant tower shall be on-line. Dryers that continue to operate the switching valves on a fixed cycle, while in purge control mode shall not be acceptable. (Dryers utilizing purge control require the optional dew point monitor listed below.) Each dryer is supplied with two stages of filtration. The pre-filter removes particulates and liquids and includes an element change indicator and automatic condensate drain. The 0.5 micron after filter includes an element change indicator. Dryers shall be powered through a separate control circuit and not through the compressor controls.

Optional Refrigerant Air Dryer

The refrigerated air dryers are non-cycling, direct expansion type, using R-134 A refrigerant (CFC free). A hot gas by-pass system maintains a consistent temperature at all load conditions. Heat exchangers are made of copper tube construction and fully insulated. Dryers shall have power on and high temperature lights, suction pressure gauge, internal 3-micron filter/separator with stainless steel bowl, and timed electric condensate drain. Refrigerated dryers are to be powered from a separate supply, not through the compressor controls.

Optional Dewpoint Monitor




NOTE: Installed on desiccant dryer.

The system-integrated hygrometer shall be equipped with an LCD dewpoint display and high dewpoint alarm with dry contacts for remote monitoring. The sensor shall include an auto calibration feature to ensure the accuracy of the dewpoint measurement.

Optional Moisture Separator

The moisture separator shall be sized for the peak calculated demand and shall include an auto float drain to purge the collected moisture.

Dimensions				
Model	Dim. A	Dim. B	Dim. C	Outlet
SEQ40B	47"	73"	62"	1 ½"
SEH45B	47"	73"	62"	1 ½"
SEP50B	47"	73"	62"	1 ½"
SEH60B	47"	73"	62"	1 ½"

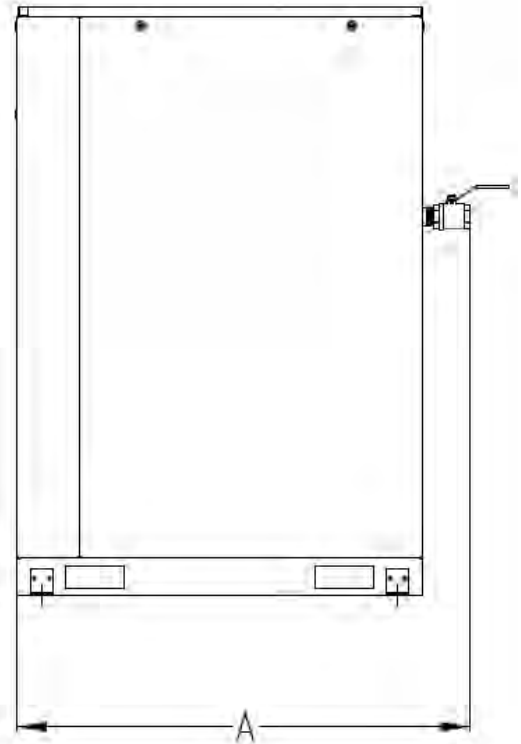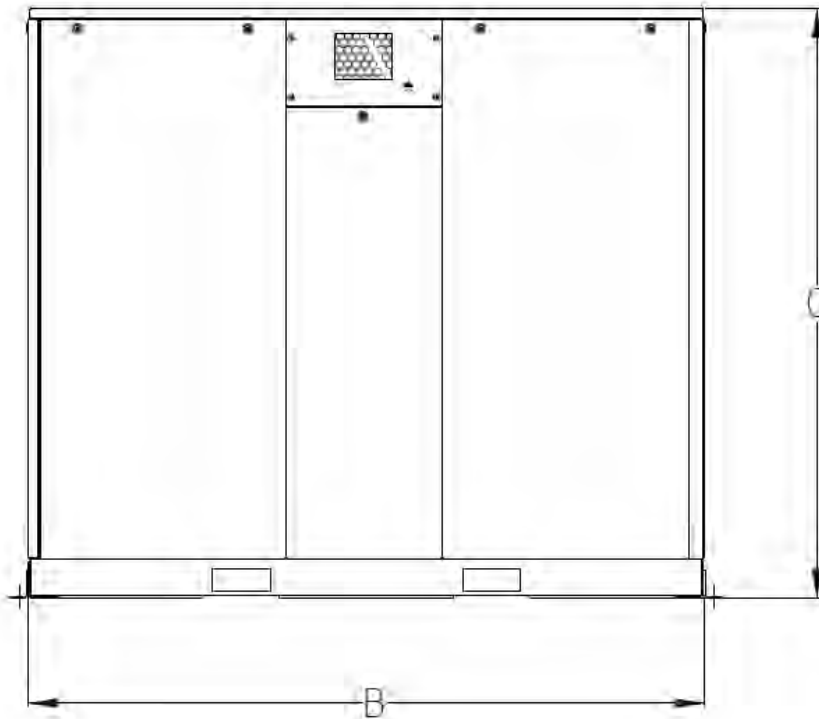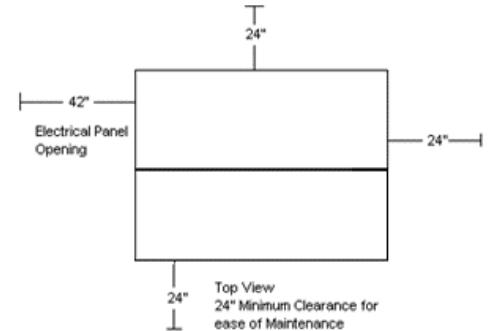

Enclosed Scroll Air Compressors										
Model	Total System HP	Pump HP ¹	SCFM @ 100 PSIG	Maximum Pressure (PSIG)	BTU/Hr	dB(A) Level	System F.L.A.			System Weight (lbs)
							208V	230V	460V	
SEQ40B	40	10 (4)	125	116	101,868	66	103.6	94	48	1600
SEH45B	45	7.5 (6)	139	116	114,601	66	116.6	105.8	53.8	2140
SEP50B	50	10 (5)	156	116	127,335	67	129.0	117	59.5	1870
SEH60B	60	10 (6)	187	116	152,802	69	154.4	140	71	2140

Notes:

- 1 – Actual BHP is less than rated name plate. Contact Powerex for BHP rating.
- 2 – 3 Year Limited Warranty
- 3 – UL/CSA Certified